


B

B

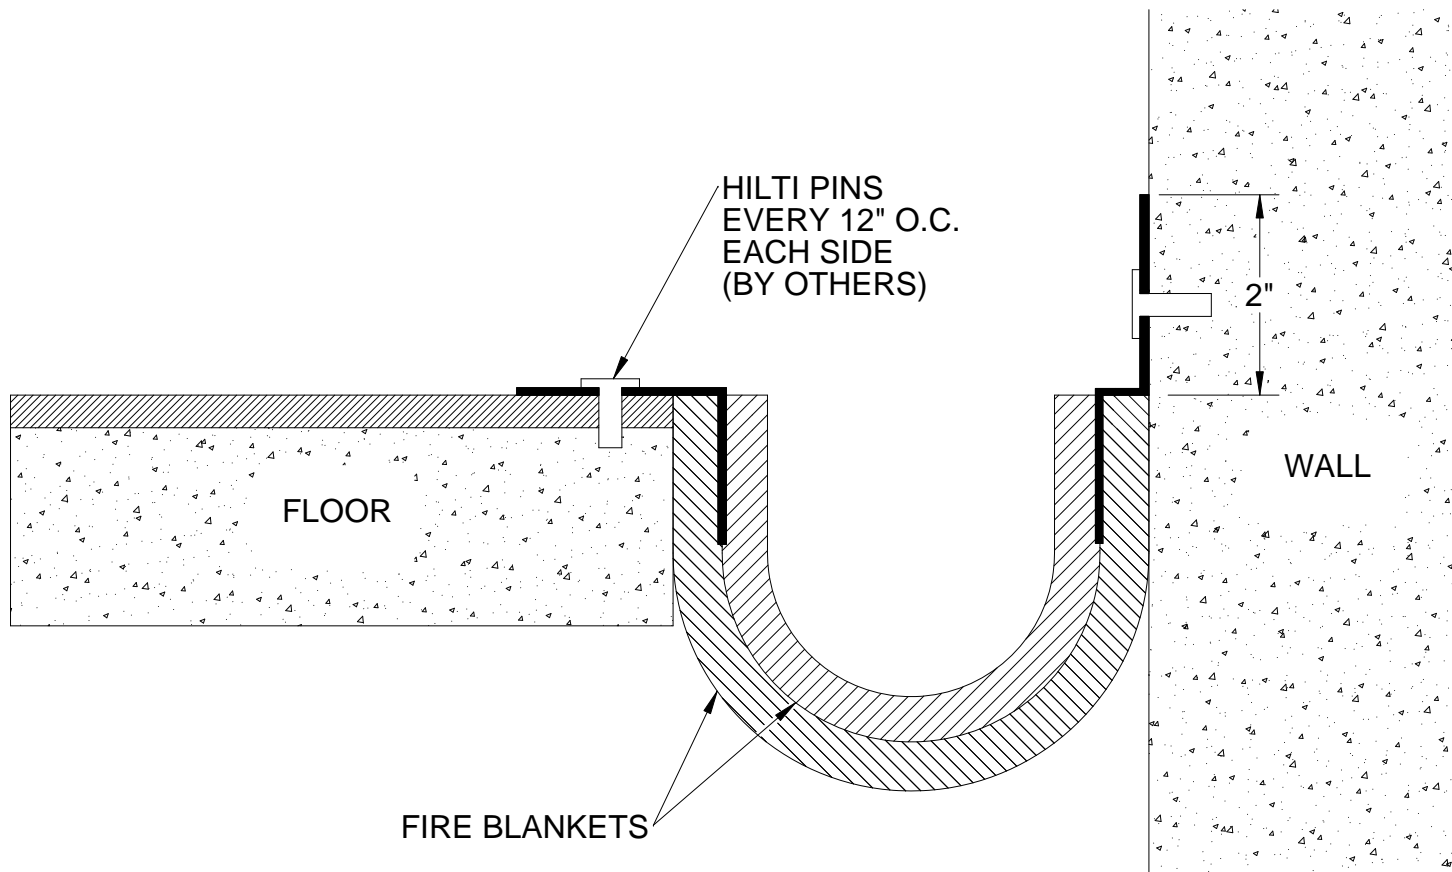


A

A

**SPECIFICATIONS:**

- 1. LISTED BY WARNOCK HERSEY U.S.A. / CANADA, 2HR., 3HR., AND 4HR. RATING
- 2. MEETS UL 2079, ULC S-115, ASTM E-1399, ASTM E-1966-01, & UL AIR LEAK TESTED
- 3. WATERGUARD / NON WATERGUARD
- 4. U.S.A. - PATENT PENDING, CANADA - PATENT PENDING

PROJECT:			
ARCHITECT:			
CONTRACTOR:			
QTY:			
PART#:			
 Right to site. 9300 73rd Avenue North Brooklyn Park, MN 55428		TITLE:	
		EJ, FIRE BARRIER TOP MOUNT, FLOOR TO WALL WATERGUARD / NON WATERGUARD	
NAME	DATE	SIZE	DWG. NO.
DRAWN	DKL	8/9/12	A
RELEASED	PGE	9/11/12	WEIGHT: MODEL DEPENDENT
			REV
			A
			SHEET 1 OF 1

PROPRIETARY AND CONFIDENTIAL: THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF NYSTROM. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF NYSTROM IS PROHIBITED.