



Wiremold

Evolution™ Series 8" Poke-Thru Devices INSTALLATION INSTRUCTIONS

Installation Instruction No.: 1 007 156 R2 – Updated May 2010

Products Covered: 8ATCP, 8ATP, 8ATC, 8AT, 8STC, 8CTC, 8CT, 68REC, 68MAAP, 682A, 68B, 8DP, 8DEC, 8S1, 8S2, 8MAAP, 8AAP, 8B, 8TS, 8STCP, 575CHA, 575PTHA, 575BLH, 175CHA, 1125CHA, 1PTHA, 1BLH, 22CHA, CE8STCP

CAUTION: DO NOT operate tile stripper, cleaning, or resurfacing equipment over top of covers. This may result in damage to the surface finish of the product.


Suitable for use in air handling spaces in accordance with Sec. 300-22 (C) of the National Electrical Code.

IMPORTANT: Please read all instructions before beginning.

FLOOR PREPARATIONS


Step 1 Layout and locate position of hole(s).

CAUTION: Minimum spacing of 2ft on center and not more than one device per each 65 square feet of floor area in each span.

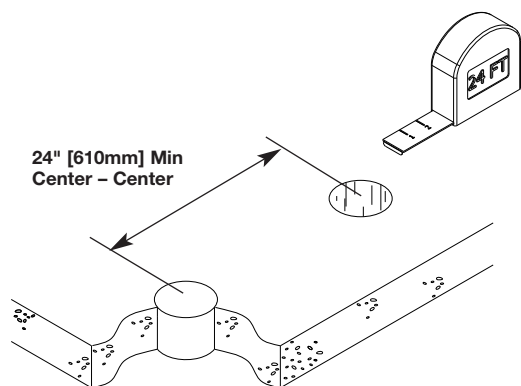


CAUTION: Be certain to locate hole at least 8" [203mm] from any wall or pillar to leave enough room for Poke-Thru cover assembly.

Step 2 Remove 8 1/2" dia. [216mm] section from carpet or tile. Use template provided.

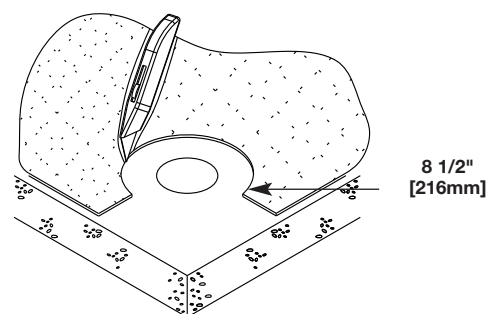

Step 3 Create core hole according to the dimensions provided in the chart.

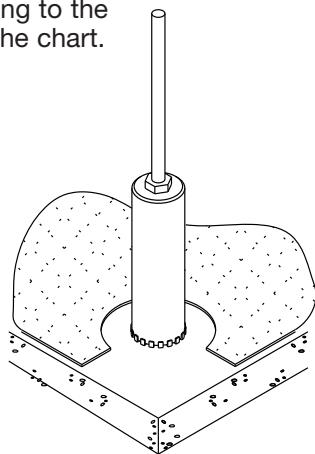

FLOOR TYPE	CORE SIZE (Min.)	CORE SIZE (Max.)
Covered Floors (Carpet, Tile or Wood)	8" [203mm]	8 1/8" [206mm]
Bare Concrete or Terrazzo	8 1/16" [205mm]	8 1/8" [206mm]


Wiremold electrical systems conform to and should be properly grounded in compliance with requirements of the current National Electrical Code or codes administered by local authorities.

All electrical products may present a possible shock or fire hazard if improperly installed or used. Wiremold electrical products may bear the mark as UL Listed and/or Classified and should be installed in conformance with current local and/or the National Electrical Code.

INSTALLING COMPLETE ASSEMBLY

- Step 1** Attach data and AV plates and wire power and data devices (Can be completed above floor). Refer to wiring schematic below for power wiring options.

Catalog Nos. 8ATCP, 8ATP

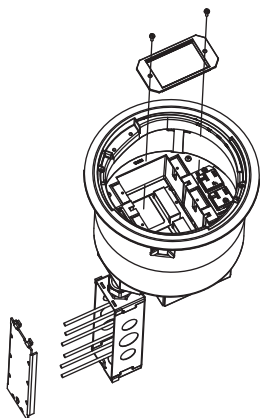

Circuit A Wiring

Circuit B Wiring


CONVENTIONAL WIRING SCHEMATIC		ISOLATED GROUND WIRING SCHEMATIC		CONVENTIONAL WIRING SCHEMATIC		ISOLATED GROUND WIRING SCHEMATIC	
BLACK or HOT From branch circuit	BLACK from Poke-Thru receptacle	BLACK or HOT From branch circuit	BLACK from Poke-Thru receptacle	BLACK or HOT From branch circuit	RED from Poke-Thru receptacle	BLACK or HOT From branch circuit	RED from Poke-Thru receptacle
WHITE or NEUTRAL From branch circuit	WHITE from Poke-Thru receptacle	WHITE or NEUTRAL From branch circuit	WHITE from Poke-Thru receptacle	WHITE or NEUTRAL From branch circuit	WHITE W/ BLUE STRIPE from Poke-Thru receptacle	WHITE or NEUTRAL From branch circuit	WHITE W/ BLUE STRIPE from Poke-Thru receptacle
GREEN or GROUND From branch circuit System Ground	GREEN from Poke-Thru receptacle	ISOLATED GROUND From branch circuit	GREEN from Poke-Thru receptacle	GREEN or GROUND From branch circuit System Ground	GREEN W/ YELLOW STRIPE from Poke-Thru receptacle	ISOLATED GROUND From branch circuit	GREEN W/ YELLOW STRIPE from Poke-Thru receptacle
GREEN (jumper wire) from Poke-Thru junction box		GREEN or GROUND From branch circuit System Ground		GREEN (jumper wire) from Poke-Thru junction box		GREEN or GROUND From branch circuit System Ground	
		GREEN (jumper wire) from Poke-Thru junction box				GREEN (jumper wire) from Poke-Thru junction box	

WARNING: Ground wire from junction box must be connected to system ground.

CAUTION: Receptacle mounting means not grounded. Grounding wire connection required. For isolated ground wiring, connect ground leads to a separate isolated grounding conductor. See NEC 250-146(d).


If necessary remove Feed Plates to pull communications wires through Poke-Thru device. Replace Feed Plates when finished pulling wires.

Catalog Nos. 8ATCP, 8ATP

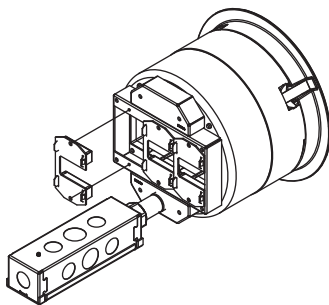

CAUTION: To maintain fire classification, Feed Plates must be installed.


Step 2 If circuit is connected to an isolated ground, apply IG icon on receptacle plate as shown.

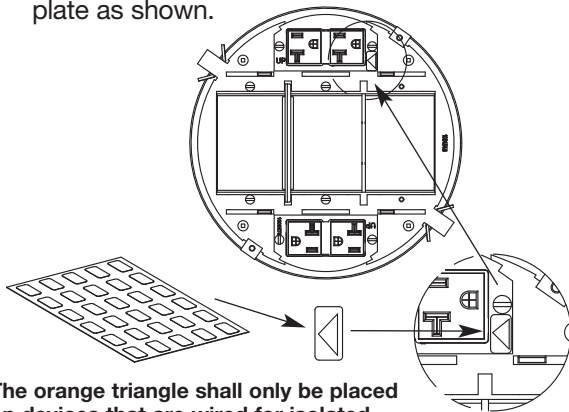


NOTE: The orange triangle shall only be placed on devices that are wired for isolated ground. See NEC 250-146(d).

For Carpet or Surface Mounted Tile Installation


Step 3 Place appropriate gasket around poke thru and slide under flange. Use flat foam gasket for surface tile applications or use round neoprene gasket for carpet applications. For the flush tile applications no gasket is needed.

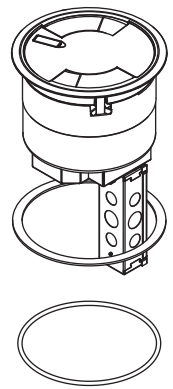

Step 4 Push Poke-Thru into floor.

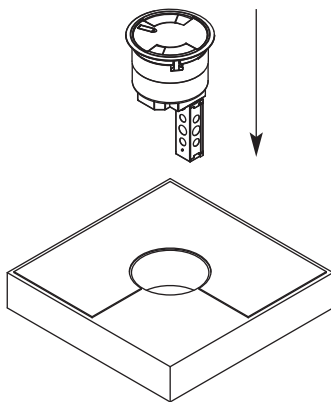


Step 5 Installation complete.

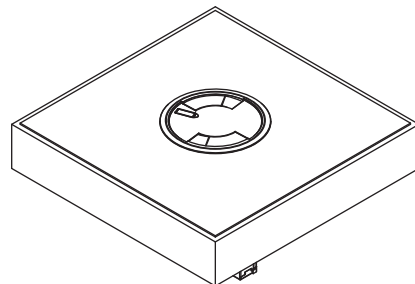


For Flush Tile Installation (Start with Steps 1 & 2 on previous page.)

Step 3 Place shims around bottom of flange to match thickness of tile. Flange is 1/8" thick. (2) 1/8" shims and (2) 1/16" shims are provided. Push Poke-Thru into floor.

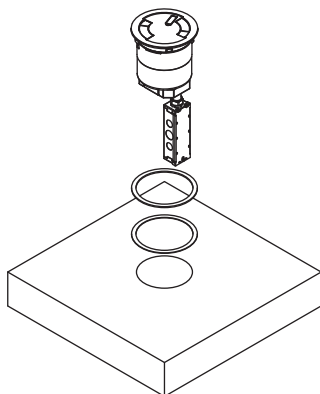


NOTE: If more shims are required, use Cat. No 8TS.

Step 4 Use grout and/or silicone caulk between edges of flange and tile.

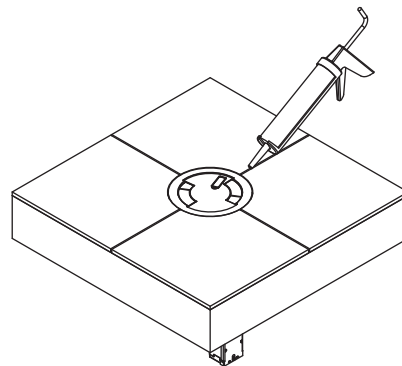


INSTALLING STEM ASSEMBLY AND SEPARATE COVER

Step 1 Insert Stem Assembly into core hole.

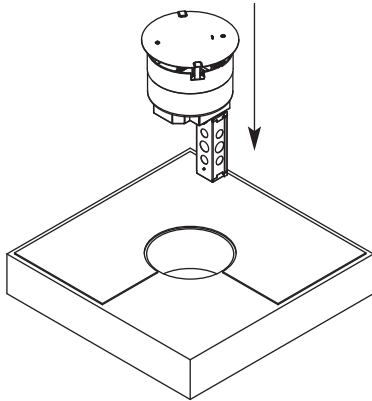


Step 2 Remove disposable plate and (2) plate clips by removing the 8-32 screws. Install Flange using the (2) 8-32 x 1/2" Cap Head screws provided with the cover assembly.

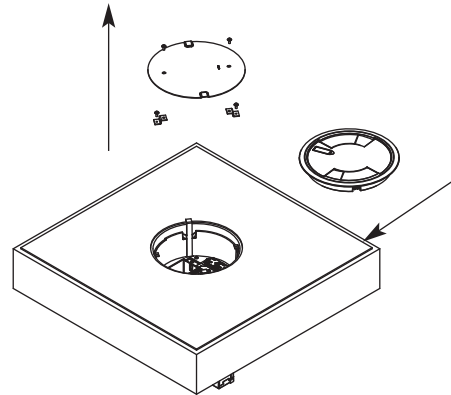


INSTALLING DIVIDERS

Step 1 Slide divider into slots in body of Poke Thru. Two sets of slots are provided. Either set may be used.

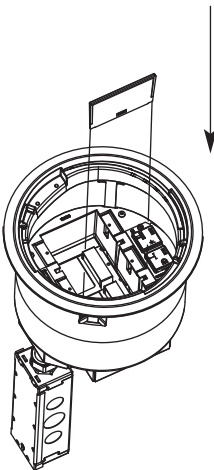


Step 2 Two dividers are provided for the bottom of the Poke Thru. Use the shorter divider on top of Wire Tunnel. Use the longer divider when separating channels without the Wire Tunnel. To install, turn divider at an angle to place inside the Feed Housing. Once inside, twist the divider to align with holes in the Feed Housing. Attach using (2) # 8-32 screws.

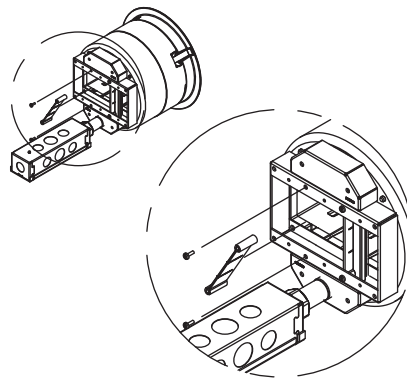

INSTALLING DEVICE PLATES


Half Gang Plates

Step 1 Install plates using (2) 6-32 x 1/2" screws.
(provided)

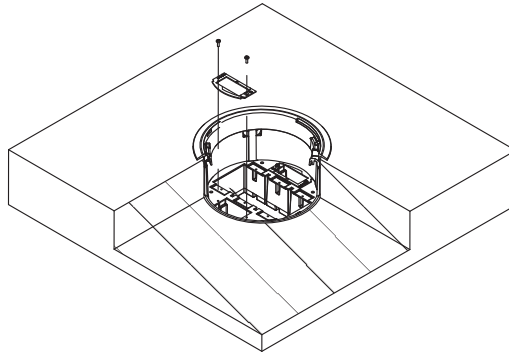


NEMA 1 Gang Device

Step 1 Screw receptacle into tabs using (2) 6-32 screws provided with the receptacle.

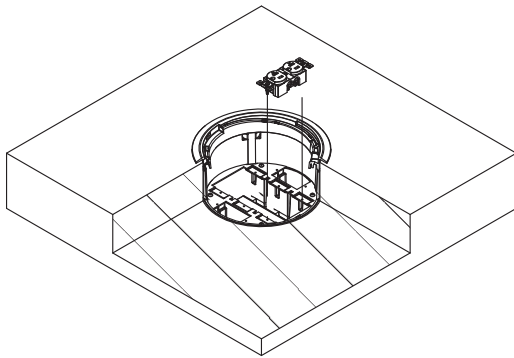


Step 2 Install plates using (2) 6-32 x 1/2" screws.
(provided)

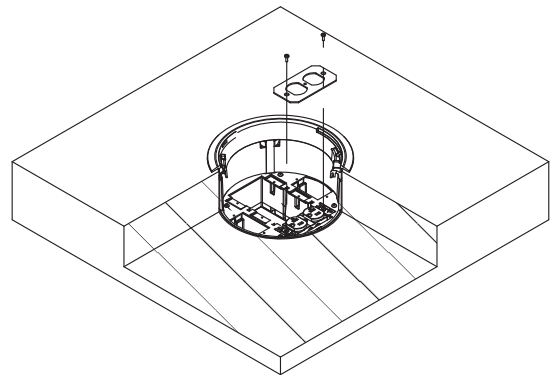


1.5 Gang Data/AV Plates

Step 1 Install device plate using (2) 6-32 x 1/2" screws. (provided)

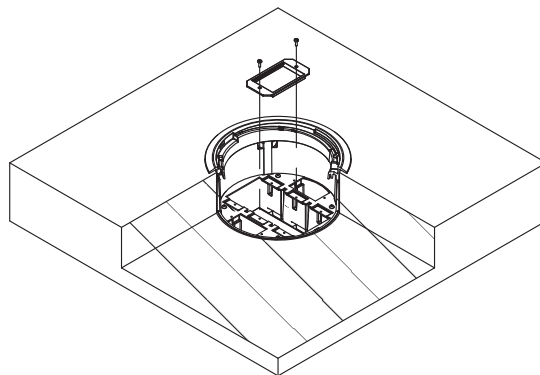


Carpet Cutout Template

Carpet Cutout
8 1/2" [216mm]

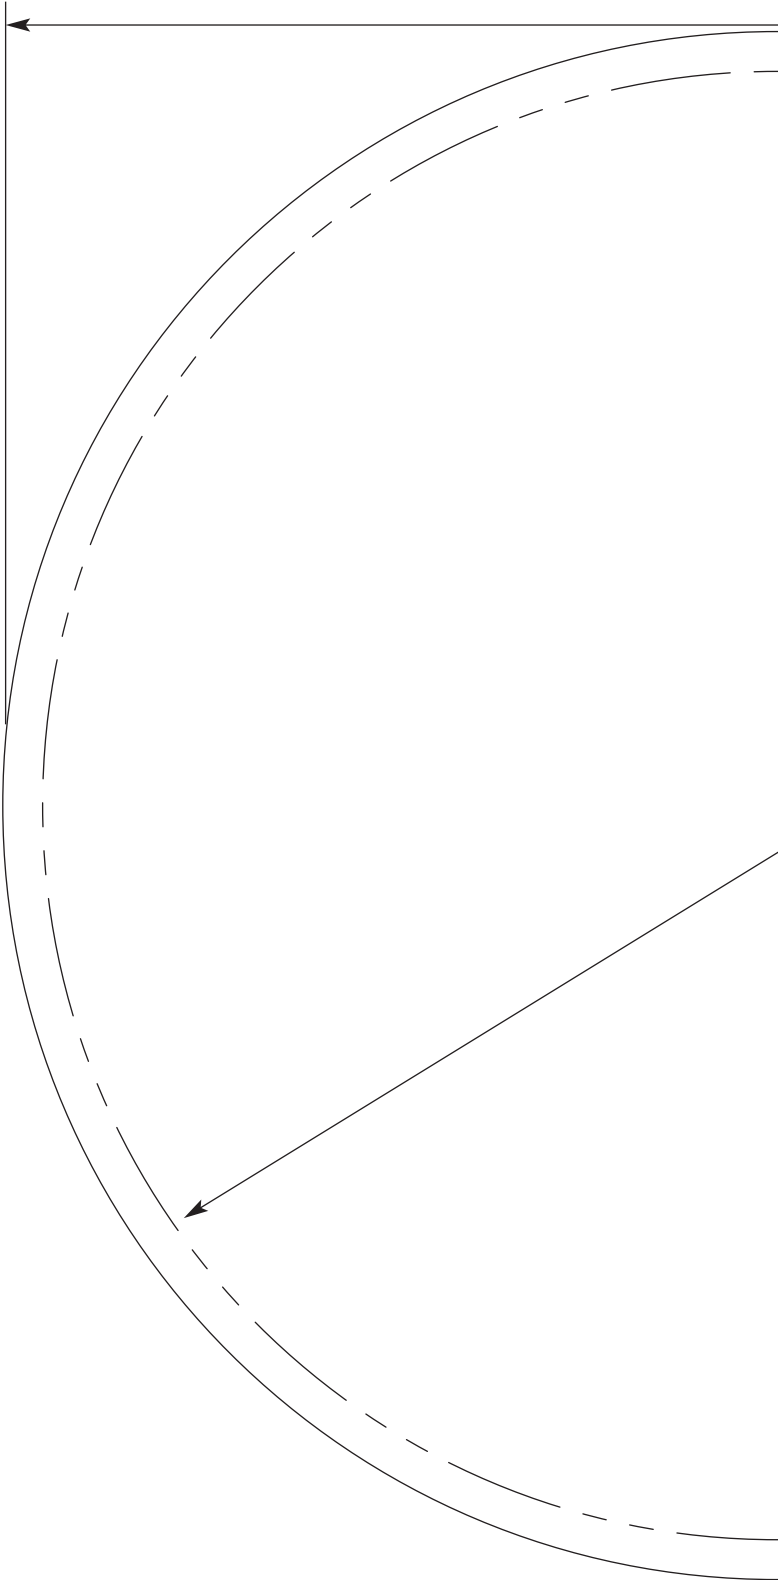


CAUTION: When printing copies of this template please be sure template is scaled correctly and is the correct size once it is printed.

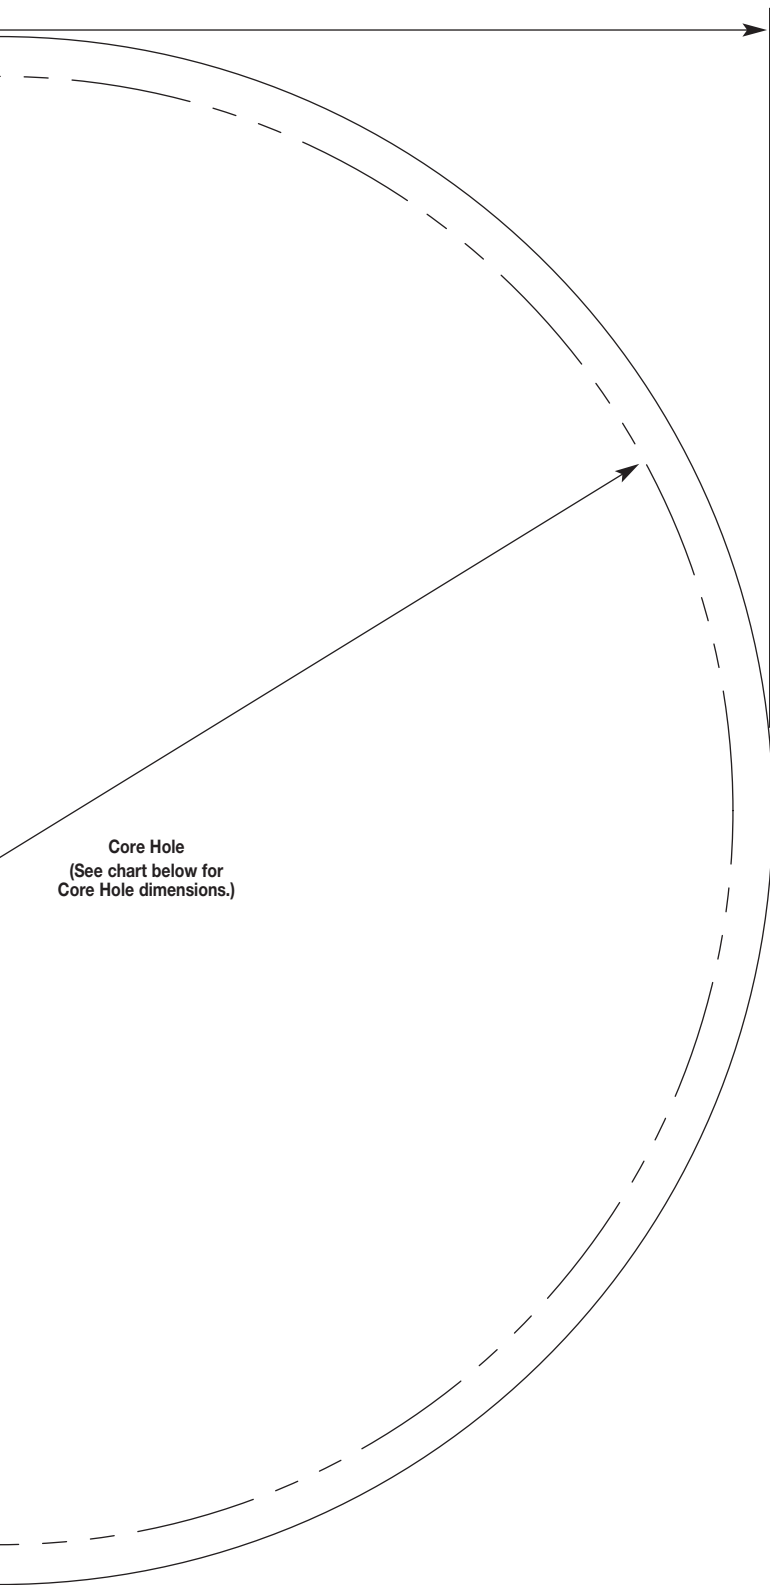


FLOOR TYPE	CORE SIZE (Min.)	CORE SIZE (Max.)
Covered Floors (Carpet, Tile or Wood)	8" [203mm]	8 1/8" [206mm]
Bare Concrete or Terrazzo	8 1/16" [205mm]	8 1/8" [266mm]

CONFIGURING FEED PLATES


- Step 1** Remove cover assembly from Poke Thru by removing (2) 8-32 screws and lifting cover off.

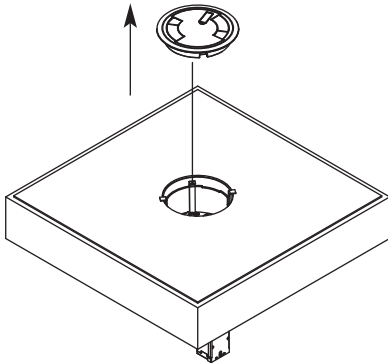

- Step 2** Remove Poke Thru from floor by bending tabs inward and pulling unit up.

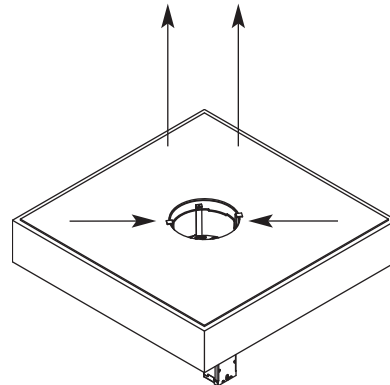


- Step 1** Remove (2) 8-32 screws and pull off Feed Plate or housing.

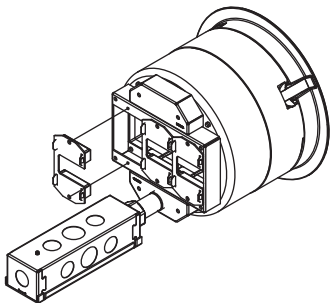

CAUTION: To maintain fire classification, Feed Plates must be installed.


- Step 2** Use (2) 8-32 screws to install new Feed Plate or housing

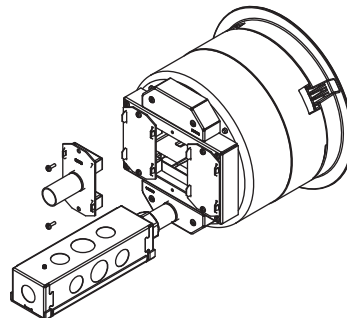


CAUTION: To maintain fire classification, Feed Plates must be installed.

WIRE TUNNEL REMOVAL


Step 1 Remove Feed Housing from center and side without J-box.

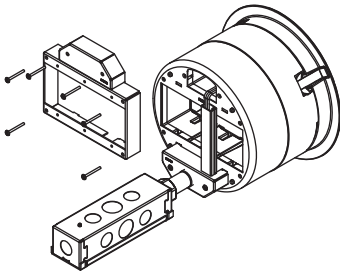


Step 2 Pull wires out of wire tunnel.

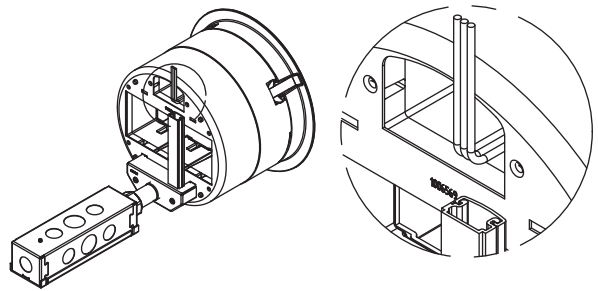


Step 3 Slide wire tunnel out of remaining Feed Housing.

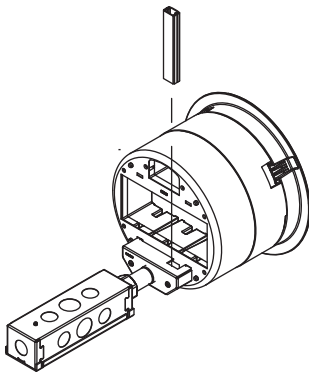

Step 4 Rotate center housing and reattach with (4) 8-32 screws.

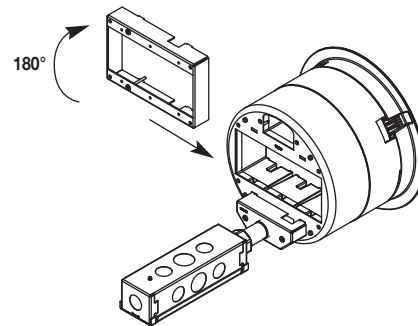


Step 5 Reattach side Feed Housing and feed plate with (2) 8-32 screws.

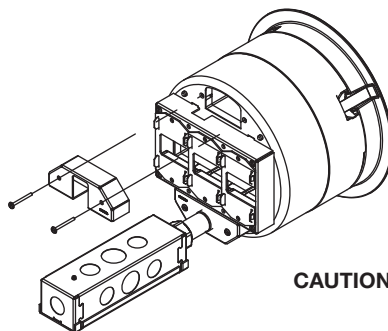


CAUTION: To maintain fire classification, Feed Plates must be installed.

INSTALLING DEVICES IN DEVICE PLATES


8TRAC, 8SER, 8ACT6A
(Devices not included)

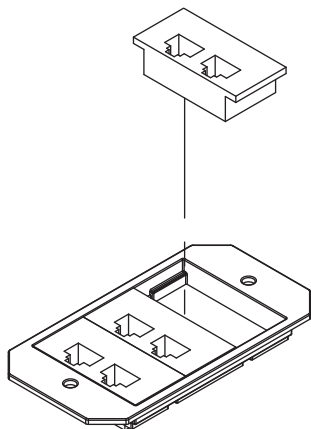

8MAAP, 8AAP, 68MAAP
(Devices not included)

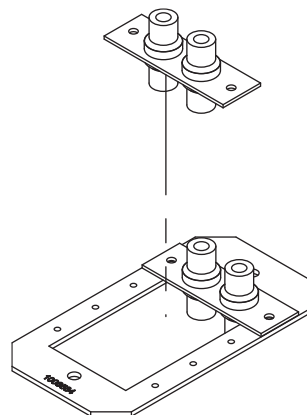

682A
(Includes 2A bezels. Devices not included)

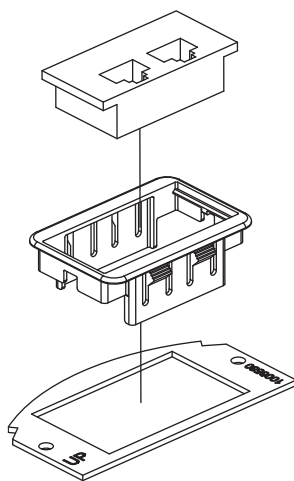

Evolution Series Poke-Thru Devices are UL Listed and Classified to U.S. and Canadian safety standards to the following conditions:

The 8STC Poke-Thru Stem with the 8CTC or 8CT Service Head Fitting, and the 8ATCP, 8ATP, 8ATC or 8AT factory assembled Poke-Thru devices are for use with 1-, 1 1/2-, or 2- hour rated unprotected reinforced concrete floors and 1-, 1 1/2-, or 2- hour rated floors employing unprotected steel floor units and concrete topping (D900 Series Designs), or concrete floors with suspended ceilings. (Fire resistive designs with suspended ceilings should have provisions for accessibility in the ceiling area below the Poke-Thru fittings).

The assembled Poke-Thru stem and service fitting will not reduce the ratings of the floor assembly when the thickness and type of concrete (required for the specific rating) are within the specified limits and the fittings are installed as specified:

- 1. Spacing** – Minimum of 2' [610mm] OC and not more than one unit per 65 sq. ft. [6 m²] of floor area in each span.
- 2. Concrete** – Minimum thickness of structural concrete topping of 2 1/4" [57mm] over metal deck or a minimum 3" [76mm] thick reinforced concrete slab. Unit weight of concrete to be 110 to 155 pcf.
- 3. Installation** – Mounted in a 8" [203mm] diameter hole in concrete per installation instructions accompanying the fittings. For use with power circuits, data and/or audio/visual cables as tabulated below:

COPPER CROSS-SECTION

	OUTER CHANNELS	CENTER CHANNEL
Max Copper X-Section	.0154 sq. in. [9.9mm ²]	.0775 sq. in. [16.6 mm ²]
Max # Conductors	(3) 12 AWG	(24) 14 AWG

NOTE: When using conductor sizes other than listed above, the aggregate cross-sectional area of the copper conductors shall not exceed the cross-sectional areas listed.

The "TC" suffix letters indicate that the device may be installed on tile or carpet covered concrete floors. The "T" suffix letter indicates that the device is intended to be installed on a concrete floor, embedded into the tile covering.

Copper Cross Sectional Area of Commonly Used Conductors	
Size	Solid
#24	.00032 sq. in. [.20645mm ²]
#22	.00050 sq. in. [.32258mm ²]
#14	.00323 sq. in. [2.08386mm ²]
#12	.00512 sq. in. [3.30321mm ²]
#10	.00815 sq. in. [5.25805mm ²]
#8	.01296 sq. in. [8.36127mm ²]

NOTE: Use above values for solid or stranded conductors.

CAUTION: Receptacle supplied with this Poke-Thru is not suitable for direct field wiring. Contact manufacturer for replacement. Field modifications will void UL Listing and Classification. Replacement receptacle is limited to this manufacturers' Catalog No 68REC.



Wiremold

Wiremold

U.S. and International:

60 Woodlawn Street • West Hartford, CT 06110
1-800-621-0049 • FAX 860-232-2062 • Outside U.S.: 860-233-6251

Canada:

570 Applewood Crescent • Vaughan, Ontario L4K 4B4
1-800-723-5175 • FAX 905-738-9721

